




# Digital Receipt

This receipt acknowledges that **Turnitin** received your paper. Below you will find the receipt information regarding your submission.

The first page of your submissions is displayed below.

Submission author: Turnitin Instructor  
Assignment title: Plagiasi Jurnal Teknik 2  
Submission title: Performance Comparison of Proportional-Integral and Fuzzy...  
File name: al-Integral\_and\_Fuzzy-PI\_for\_a\_Droop\_Control\_of\_DC\_Microg...  
File size: 272.5K  
Page count: 5  
Word count: 3,294  
Character count: 17,209  
Submission date: 20-Mar-2024 09:57PM (UTC+0700)  
Submission ID: 2321976477

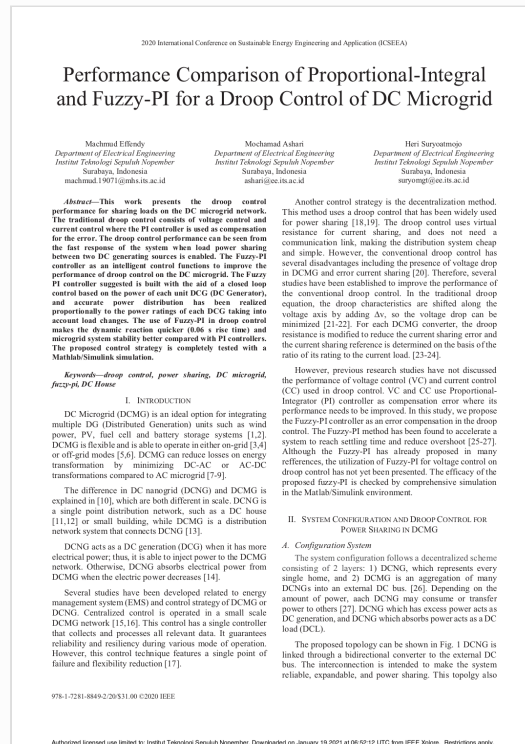

# Performance Comparison of Proportional-Integral and Fuzzy-PI for a Droop Control of DC Microgrid

*by* Turnitin Instructor

---

**Submission date:** 20-Mar-2024 09:57PM (UTC+0700)

**Submission ID:** 2321976477

**File name:** al-Integral\_and\_Fuzzy-PI\_for\_a\_Droop\_Control\_of\_DC\_Microgrid.pdf (272.5K)

**Word count:** 3294

**Character count:** 17209

# Performance Comparison of Proportional-Integral and Fuzzy-PI for a Droop Control of DC Microgrid

Machmud Effendy

Department of Electrical Engineering  
Institut Teknologi Sepuluh Nopember  
Surabaya, Indonesia  
machmud.19071@mhs.its.ac.id

Mochamad Ashari

Department of Electrical Engineering  
Institut Teknologi Sepuluh Nopember  
Surabaya, Indonesia  
ashari@ee.its.ac.id

Heri Suryatomojo

Department of Electrical Engineering  
Institut Teknologi Sepuluh Nopember  
Surabaya, Indonesia  
suryomgt@ee.its.ac.id

**Abstract**—This work presents the droop control performance for sharing loads on the DC microgrid network. The traditional droop control consists of voltage control and current control where the PI controller is used as compensation for the error. The droop control performance can be seen from the fast response of the system when load power sharing between two DC generating sources is enabled. The Fuzzy-PI controller as an intelligent control functions to improve the performance of droop control on the DC microgrid. The Fuzzy PI controller suggested is built with the aid of a closed loop control based on the power of each unit DCG (DC Generator), and accurate power distribution has been realized proportionally to the power ratings of each DCG taking into account load changes. The use of Fuzzy-PI in droop control makes the dynamic reaction quicker (0.06 s rise time) and microgrid system stability better compared with PI controllers. The proposed control strategy is completely tested with a Matlab/Simulink simulation.

**Keywords**—droop control, power sharing, DC microgrid, fuzzy-pi, DC House

## I. INTRODUCTION

DC Microgrid (DCMG) is an ideal option for integrating multiple DG (Distributed Generation) units such as wind power, PV, fuel cell and battery storage systems [1,2]. DCMG is flexible and is able to operate in either on-grid [3,4] or off-grid modes [5,6]. DCMG can reduce losses on energy transformation by minimizing DC-AC or AC-DC transformations compared to AC microgrid [7-9].

The difference in DC nanogrid (DCNG) and DCMG is explained in [10], which are both different in scale. DCNG is a single point distribution network, such as a DC house [11,12] or small building, while DCMG is a distribution network system that connects DCNG [13].

DCNG acts as a DC generation (DCG) when it has more electrical power; thus, it is able to inject power to the DCMG network. Otherwise, DCNG absorbs electrical power from DCMG when the electric power decreases [14].

Several studies have been developed related to energy management system (EMS) and control strategy of DCMG or DCNG. Centralized control is operated in a small scale DCMG network [15,16]. This control has a single controller that collects and processes all relevant data. It guarantees reliability and resiliency during various mode of operation. However, this control technique features a single point of failure and flexibility reduction [17].

Another control strategy is the decentralization method. This method uses a droop control that has been widely used for power sharing [18,19]. The droop control uses virtual resistance for current sharing, and does not need a communication link, making the distribution system cheap and simple. However, the conventional droop control has several disadvantages including the presence of voltage drop in DCMG and error current sharing [20]. Therefore, several studies have been established to improve the performance of the conventional droop control. In the traditional droop equation, the droop characteristics are shifted along the voltage axis by adding  $\Delta v$ , so the voltage drop can be minimized [21-22]. For each DCMG converter, the droop resistance is modified to reduce the current sharing error and the current sharing reference is determined on the basis of the ratio of its rating to the current load. [23-24].

However, previous research studies have not discussed the performance of voltage control (VC) and current control (CC) used in droop control. VC and CC use Proportional-Integrator (PI) controller as compensation error where its performance needs to be improved. In this study, we propose the Fuzzy-PI controller as an error compensation in the droop control. The Fuzzy-PI method has been found to accelerate a system to reach settling time and reduce overshoot [25-27]. Although the Fuzzy-PI has already proposed in many references, the utilization of Fuzzy-PI for voltage control on droop control has not yet been presented. The efficacy of the proposed fuzzy-PI is checked by comprehensive simulation in the Matlab/Simulink environment.

## II. SYSTEM CONFIGURATION AND DROOP CONTROL FOR POWER SHARING IN DCMG

### A. Configuration System

The system configuration follows a decentralized scheme consisting of 2 layers: 1) DCNG, which represents every single home, and 2) DCMG is an aggregation of many DCNGs into an external DC bus. [26]. Depending on the amount of power, each DCNG may consume or transfer power to others [27]. DCNG which has excess power acts as DC generation, and DCNG which absorbs power acts as a DC load (DCL).

The proposed topology can be shown in Fig. 1 DCNG is linked through a bidirectional converter to the external DC bus. The interconnection is intended to make the system reliable, expandable, and power sharing. This topology also

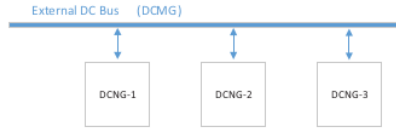


Fig. 1. A DCMG composed of connected DCNGs

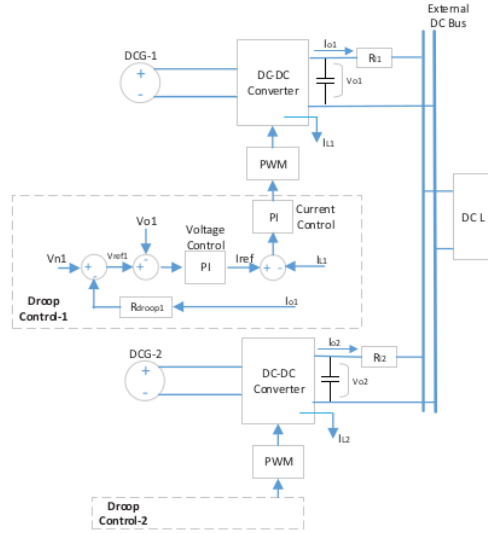


Fig. 2. Droop Control Architecture for DCMG

make system expandable, since DCNG will freely connect or disconnect based on the specifications of the consumer. Furthermore, since there is no data transmission connection in the proposed topology, each DCNG can operate independently and rely on local measurements and controllers to improve system reliability.

#### B. Droop Control

Fig. 2 illustrates droop control architecture in DCMG, where just two DCGs and one DCL are considered to simplify the analysis. The purpose of the drooping control loop is to ensure that each DCG delivers power according to its power capacity. The real voltage of each converter  $V_{oi}$  is compared to the reference voltage  $V_{refi}$  obtained from the discrepancy between the nominal voltage  $V_{ni}$  (at no load) and the voltage drop.

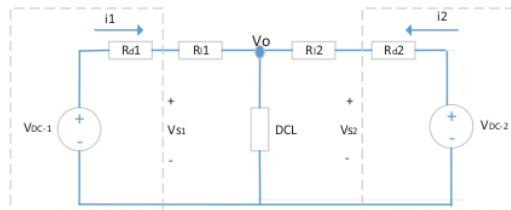


Fig. 3. Circuit model of two DCG units paralleling connected

The droop control loops consist of an voltage control loop and current control loop. The function of the voltage control is to set the reference current. While current control loop functions to regulate the output current ( $I_{oi}$ ) to find the reference value.  $I_{Li}$  is the inductor current in the DC-DC Converter circuit. Both control loops use conventional PI to compensate for errors. The values of  $K_p$  and  $K_i$  can be tuned using the Ziegler Nichols method. However, the load conditions greatly affect the performance of the system. When the load current fluctuates, the system performance changes. Therefore, the PI gains ought to be tuned based on the load condition such as the maximum load. This problem can be solved by a fuzzy PI and so the system performance could also be better than PI control.

From Fig. 2, the equivalent circuit may be simplified to the equivalent circuit shown in Fig. 3.  $R_{d1}$  and  $R_{d2}$  are droop gain or virtual resistances, where each resistance value can be easily adjusted.  $R_{11}$  dan  $R_{12}$  are line resistances of DCG1 and DCG2, respectively.

Using the voltage kirchoff law the following equation is obtained

$$V_{DCj} = V_{sj} + i_j \cdot R_{dj}, \text{ where } j = 1, 2 \quad (1)$$

where  $V_{DCj}$ ,  $V_{sj}$ ,  $i_j$ , and  $R_{dj}$  are reference voltage at no load, output voltage, output current of source converter, and droop resistance. The output voltage of source converter can be deduced from (2).

$$V_{sj} = V_o + i_j \cdot R_{ij} \quad (2)$$

From (1) and (2), the output current is given as:

$$i_j = \frac{V_{DCj} - V_o}{(R_{dj} + R_{ij})} \quad (3)$$

The error of current sharing by two DCG is specified as:

$$\Delta i_{1,2} = \frac{(R_{d2} + R_{12})(V_{DC1} - V_o) - (R_{d1} + R_{11})(V_{DC2} - V_o)}{(R_{d1} + R_{11})(R_{d2} + R_{12})} \quad (4)$$

For equal current sharing,  $\Delta i_{1,2}$  can be reduced by adjusting the droop resistance. The voltage deviation can be written as:

$$\Delta V_j = V_{DCj} - V_{sj} = i_j \cdot R_{dj} \quad (5)$$

To limit deviation in output voltage to acceptable levels, the droop resistance  $R_{dj}$  should be limited as

$$R_{dj} \leq \frac{\Delta V_{max}}{i_{nj}} \quad (6)$$

where  $i_{nj}$  is full load current of source DCG.

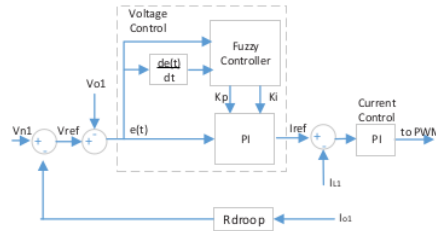
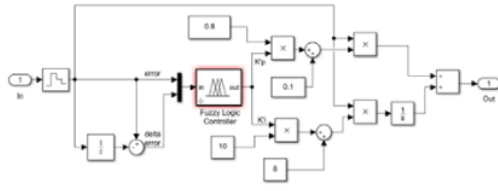


Fig. 4. The proposed control block diagram of droop control





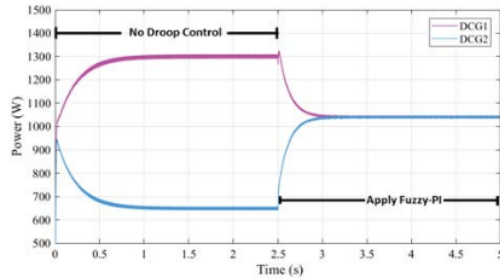


Fig. 10. Dynamic response of system with Fuzzy-PI

#### A. Performance of Droop Control with Load Sharing

Figs. 9 and 10 shows the system's dynamic performance in standard PI and Fuzzy-PI controller. From 0 to 2.5s, droop control is disabled, each DCG has a different power due to the varying resistance of the line. The droop control is enabled at 2.5s. The Fuzzy-PI performs better with quicker response and shorter settling time compared to the conventional PI controller.

#### B. Performance of Droop Control with Load Changes

In this case, we consider the changes in load from  $R = 6\Omega$  to  $5\Omega$  at 0.5s, and then to  $5.5\Omega$  at 1s. Figs. 11 and 12 show the output power from the two DCG at different loading conditions. The Fuzzy-PI controller has faster response and smaller overshoot than the traditional controller PI. It can therefore be inferred that the proposed Fuzzy PI has the dynamic output better against the traditional PI controller. Results in Figs. 11 and 12 are justified in detail by data in Table III.

TABLE III. PERFORMANCE COMPARASION OF DROOP CONTROL

Parameter	Fuzzy-PI	PI
Rise time (s)	0.012	0.077
Settling time (s)	0.0620	0.1875
Overshoot (%)	0.617	0.926

Another effect of using the fuzzy-pid controller on the droop control is shown in Fig. 13. When the load changes, Fuzzy-pi has a faster voltage response compared to the PI controller. That occurs since the original  $K_p$  and  $K_i$  values were modified by the fuzzy logic controller so that the parameter suitable for PI were obtained. Results in Fig. 13 has been justified by Table IV.

TABLE IV. VOLTAGE PERFORMANCE COMPARISON OF DROOP CONTROL

Parameter	Fuzzy-PI	PI
Rise time (s)	0.0156	0.0686
Settling time (s)	0.0520	0.1970
Overshoot (%)	0.418	0.667

#### V. CONCLUSION

The droop control based Fuzzy-PI controller has been successfully analyzed and simulated. The validity of the proposed Fuzzy PI in droop control is verified through

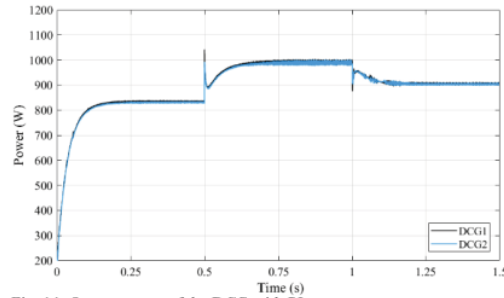


Fig. 11. Output power of the DCG with PI

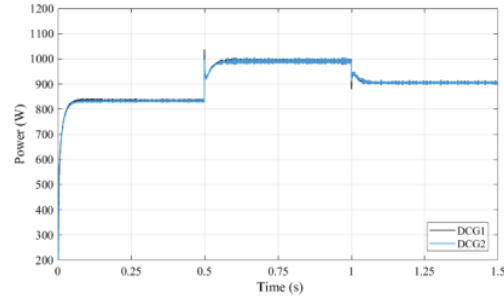


Fig. 12. Output power of the DCG with Fuzzy-PI

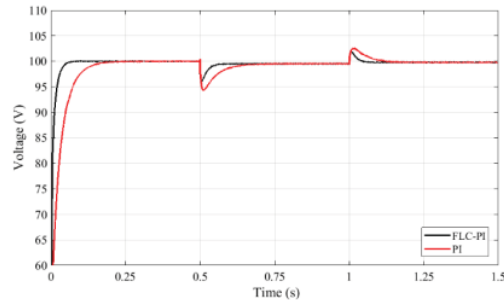


Fig. 13. Voltage comparison of droop control under load change

Matlab & Simulink simulation. The results show that the stability of the whole system can be assured. It further demonstrates that load changes in the DC MG can be regulated more adaptively. Overall, the proposed Fuzzy PID controller's nonlinear properties with variable control gains is able to improve control performance compared to those observed from the traditional PI.

#### ACKNOWLEDGMENT

The authors gave their highest appreciation to the Indonesian Endowment Fund for Education (LPDP) for funding support this doctoral research.

#### REFERENCES

- [1] T. Dragičević, X. Lu, J. C. Vasquez, and J. M. Guerrero, "DC Microgrids #x2014;Part II: A Review of Power Architectures, Applications, and Standardization Issues," *IEEE Trans. Power Electron.*, vol. 31, no. 5, pp. 3528–3549, May 2016.
- [2] J. J. Justo, F. Mwasilu, J. Lee, and J.-W. Jung, "AC-microgrids versus DC-microgrids with distributed energy resources: A review," *Renew. Sustain. Energy Rev.*, vol. 24, pp. 387–405, Aug. 2013.

- [3] S. Bifaretti, S. Cordiner, V. Mulone, V. Rocco, J. L. Rossi, and F. Spagnolo, "Grid-connected Microgrids to Support Renewable Energy Sources Penetration," *Energy Procedia*, vol. 105, pp. 2910–2915, May 2017.
- [4] A. C. Luna, N. L. Diaz, L. Meng, M. Graells, J. C. Vasquez, and J. M. Guerrero, "Generation-side power scheduling in a grid-connected DC microgrid," in *2015 IEEE First International Conference on DC Microgrids (ICDCM)*, 2015, pp. 327–332.
- [5] D. Wu, F. Tang, T. Dragicevic, J. M. Guerrero, and J. C. Vasquez, "Coordinated Control Based on Bus-Signaling and Virtual Inertia for Islanded DC Microgrids," *IEEE Trans. Smart Grid*, vol. 6, no. 6, pp. 2627–2638, Nov. 2015.
- [6] M. Tucci, S. Rivero, J. C. Vasquez, J. M. Guerrero, and G. FerrariTrecate, "A Decentralized Scalable Approach to Voltage Control of DC Islanded Microgrids," *IEEE Trans. Control Syst. Technol.*, vol. 24, no. 6, pp. 1965–1979, Nov. 2016.
- [7] D. Magdefrau, T. Taufik, M. Poshtan, M. Muscarella, "Analysis and review of DC microgrid implementations", *Proc. of International Seminar on Application for Technology of Information and Communication*, pp. 241–246, 2016.
- [8] Planas,E.; Andreu,J.;Gárate,J.I.;Alegría,I.M.;Ibarra,E.:AC and DC technology in microgrids: a review. *Renew. Sustain. Energy Rev.* 43, 726–749 (2015)
- [9] Lu, X.; Guerrero, J.M.; Sun, K.; Vasquez, J.C.; Teodorescu, R.; Huang,L.:Hierarchical control of parallel AC DC converter interfaces for hybrid microgrids. *IEEETrans.SmartGrid*2(5),683–692 (2014)
- [10] A. Werth, N. Kitamura, and K. Tanaka, "Conceptual Study for Open Energy Systems: Distributed Energy Network Using Interconnected DC Nanogrids," *IEEE Trans. Smart Grid*, vol. 6, no. 4, pp. 1621–1630, Jul. 2015.
- [11] T. Taufik, "The DC House project: An alternate solution for rural electrification", *Proc. of. IEEE Global Humanitarian Technology Conference*, pp. 174–179, Oct. 2014.
- [12] T. Taufik and M. Muscarella, "Development of DC house prototypes as demonstration sites for an alternate solution to rural electrification", *Proc. of. 6th International Annual Engineering Seminar*, pp. 262–265, 2016.
- [13] D. Burmester, R. Rayudu, W. Seah, and D. Akinyele, "A review of nanogrid topologies and technologies," *Renew. Sustain. Energy Rev.*, vol. 67, pp. 760–775, Jan. 2017.
- [14] T. L. Nguyen, J. M. Guerrero, and G. Griepentrog, "A Self-Sustained and Flexible Control Strategy for Islanded DC Nanogrids without Communication Links," *IEEE J. Emerg. Sel. Top. Power Electron.*, vol. 8, no. 1, pp. 877–892, 2020.
- [15] M. Saleh, Y. Esa, and A. Mohamed, "Centralized control for DC microgrid using finite state machine," in *2017 IEEE Power Energy Society Innovative Smart Grid Technologies Conference (ISGT)*, 2017, pp. 1–5.
- [16] A. G. Tsikalakis and N. D. Hatziargyriou, "Centralized Control for Optimizing Microgrids Operation," *IEEE Trans. Energy Convers.*, vol. 23, no. 1, pp. 241–248, Mar. 2008
- [17] S. E. Mhankale and A. R. Thorat, "Droop Control Strategies of DC Microgrid: A Review," *Proc. 2018 Int. Conf. Curr. Trends Toward Converging Technol. ICCTCT 2018*, 2018.
- [18] F. Gao et al., "Comparative Stability Analysis of Droop Control Approaches in Voltage-Source-Converter-Based DC Microgrids," *IEEE Trans. Power Electron.*, vol. 32, no. 3, pp. 2395–2415, 2017.
- [19] Y. Liu, Y. Han, C. Lin, P. Yang, and C. Wang, "Design and Implementation of Droop Control Strategy for DC Microgrid Based on Multiple DC/DC Converters," *2019 IEEE PES Innov. Smart Grid Technol. Asia, ISGT 2019*, pp. 3896–3901, 2019.
- [20] S. Augustine, M. K. Mishra, and N. Lakshminarasamma, "Adaptive Droop Control Strategy for Load Sharing and Circulating Current Minimization in Low-Voltage Standalone DC Microgrid," *IEEE Trans. Sustain. Energy*, vol. 6, no. 1, pp. 132–141, Jan. 2015.
- [21] S. Anand, B. G. Fernandes, and J. M. Guerrero, "Distributed control to ensure proportional load sharing and improve voltage regulation in low-voltage DC microgrids," *IEEE Trans. Power Electron.*, vol. 28, no. 4, pp. 1900–1913, 2013.
- [22] Y. Liu, Y. Han, C. Lin, P. Yang, and C. Wang, "Design and Implementation of Droop Control Strategy for DC Microgrid Based on Multiple DC/DC Converters," *2019 IEEE PES Innov. Smart Grid Technol. Asia, ISGT 2019*, pp. 3896–3901, 2019.
- [23] M. Mokhtar, M. I. Marei, and A. A. El-Sattar, "Improved Current Sharing Techniques for DC Microgrids," *Electr. Power Components Syst.*, vol. 46, no. 7, pp. 757–767, 2018.
- [24] Shivam and R. Dahiya, "Intelligent Distributed Control Techniques for Effective Current Sharing and Voltage Regulation in DC Distributed Systems," *Arab. J. Sci. Eng.*, vol. 42, no. 12, pp. 5071–5081, 2017.
- [25] S. Demirbas, "Self-tuning fuzzy-PI-based current control algorithm for doubly fed induction generator," *IET Renew. Power Gener.*, vol. 11, no. 13, pp. 1714–1722, 2017.
- [26] Z. Has, A. Z. Rosyidi, I. Pakaya, N. A. Mardiyah, N. Nurhadi, and M. Effendy, "Integrated Frequency Control of Microhydro Power Plant Based Flow Valve Control and Electronic Load Controller," *Proc. - 2018 IEEE Conf. Syst. Process Control. ICSPC 2018*, no. December, pp. 244–249, 2018.
- [27] V. G. Nguyen, X. Guo, C. Zhang, C. Chen, and N. T. Tran, "The analysis of electric power steering base on fuzzy-PI control," *2017 4th Int. Conf. Syst. Informatics, ICSAI 2017*, vol. 2018-January, no. Icsai, pp. 121–126, 2017.

# Performance Comparison of Proportional-Integral and Fuzzy-PI for a Droop Control of DC Microgrid

ORIGINALITY REPORT

10%  
SIMILARITY INDEX

10%  
INTERNET SOURCES

2%  
PUBLICATIONS

7%  
STUDENT PAPERS

MATCH ALL SOURCES (ONLY SELECTED SOURCE PRINTED)

2%

★ Submitted to Universiti Teknologi Malaysia  
Student Paper

Exclude quotes      Off  
Exclude bibliography      On

Exclude matches      < 2%